



案内図

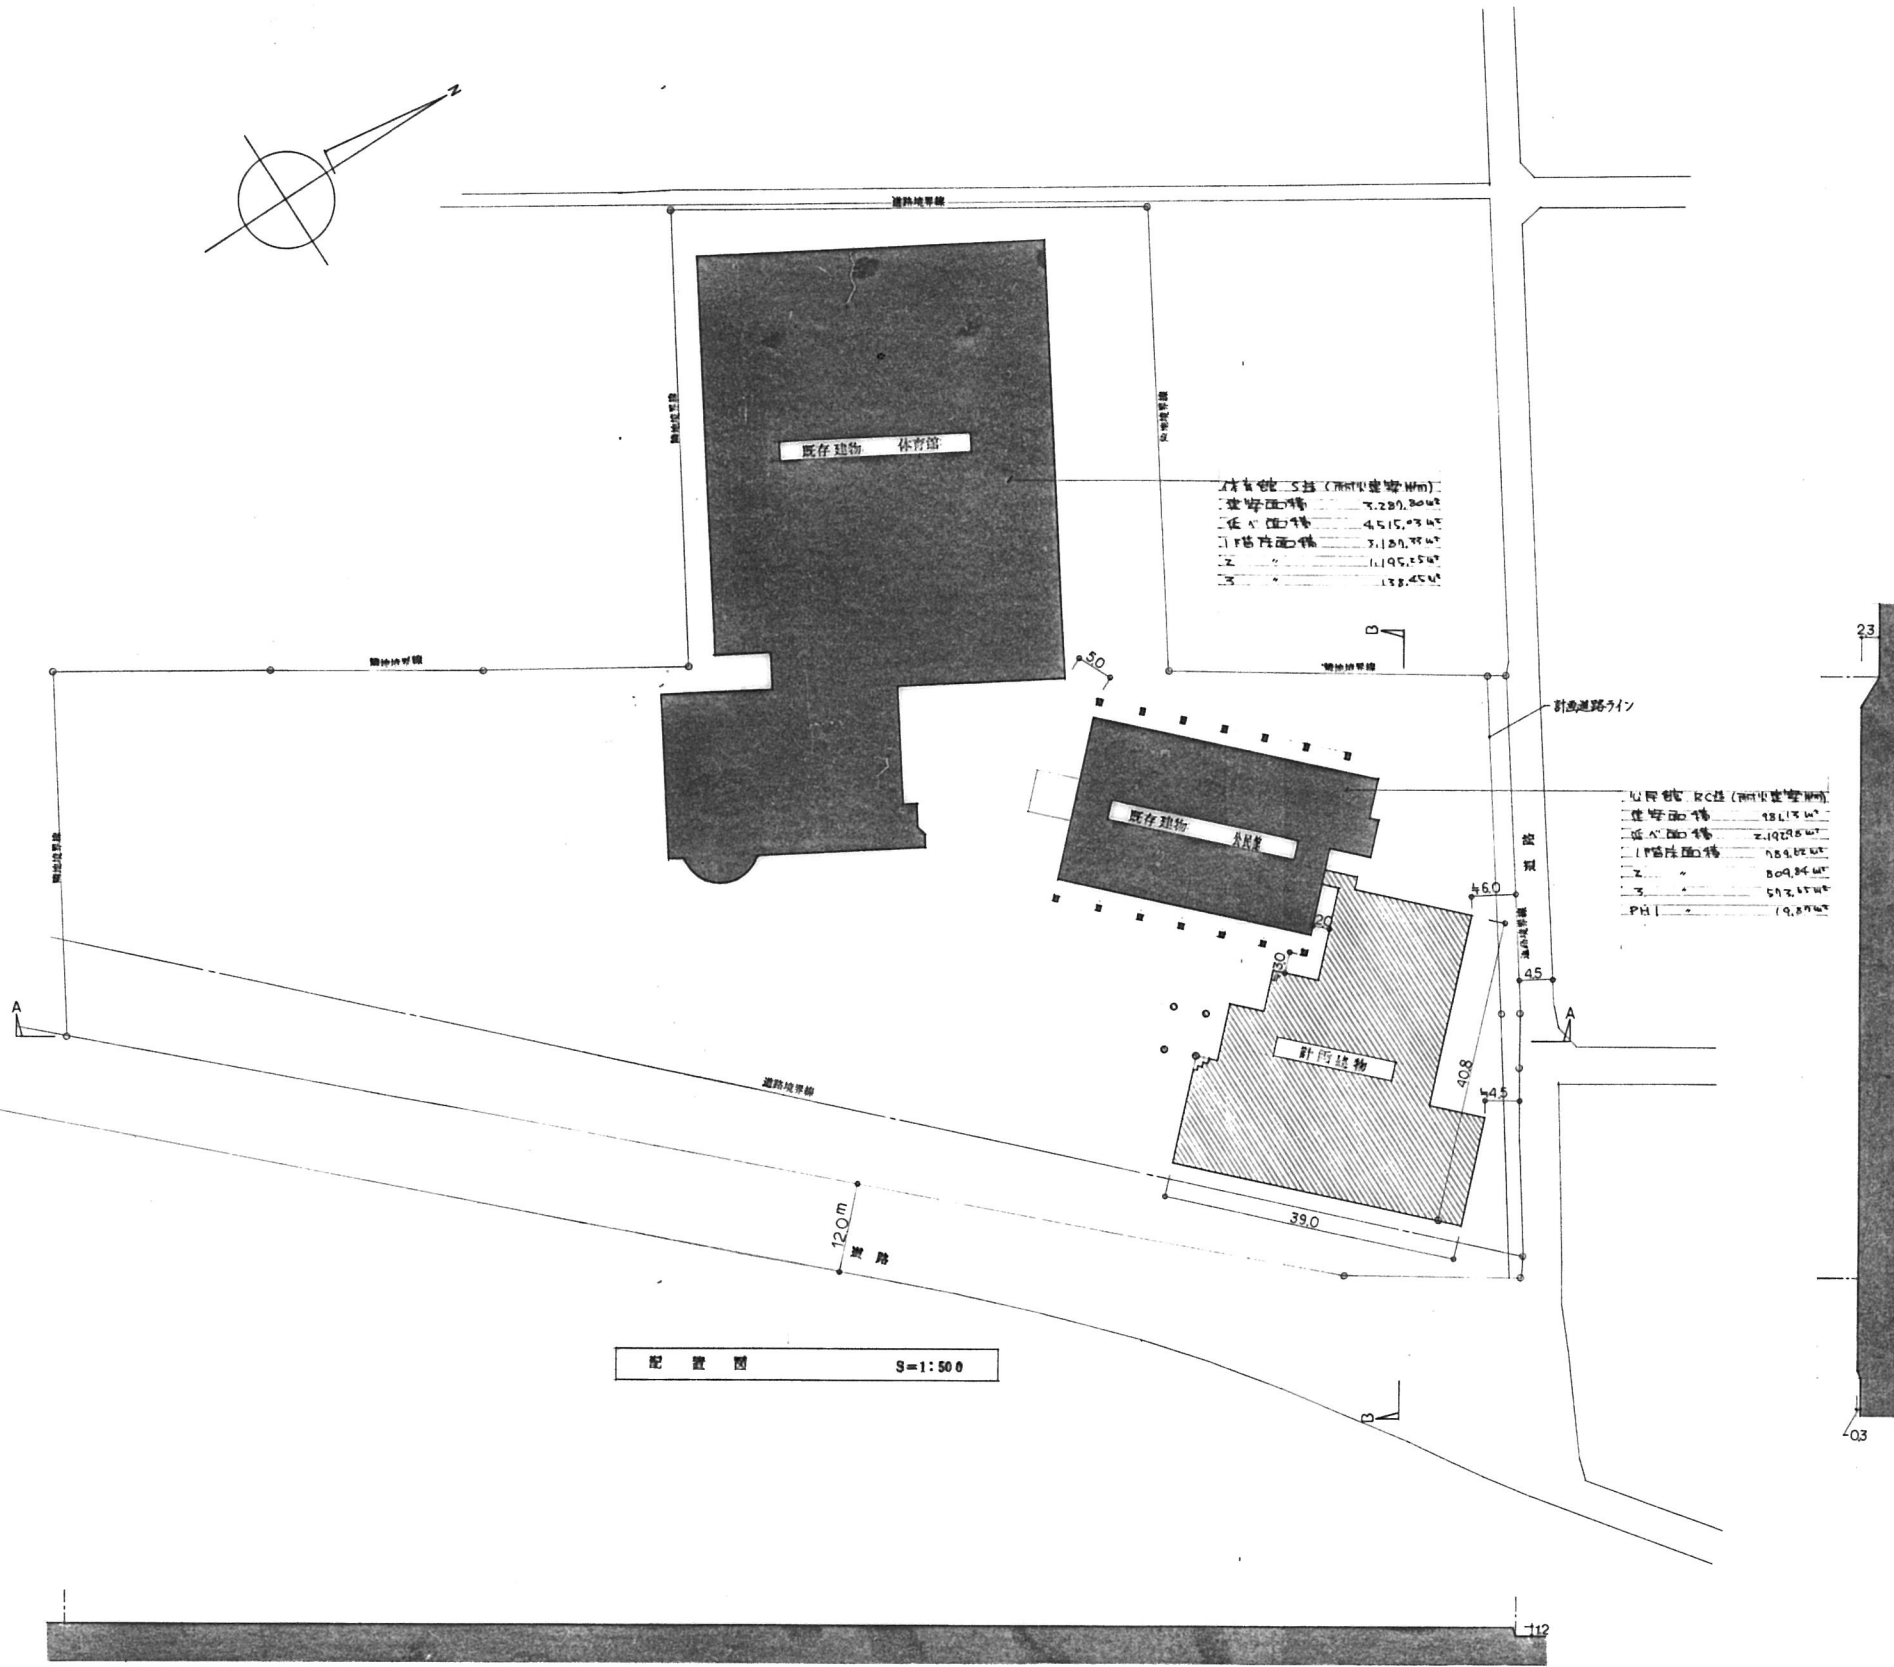


配置図 S=1:500

A—A 断面図 S=1:500

B—B 断面図 S=1:500

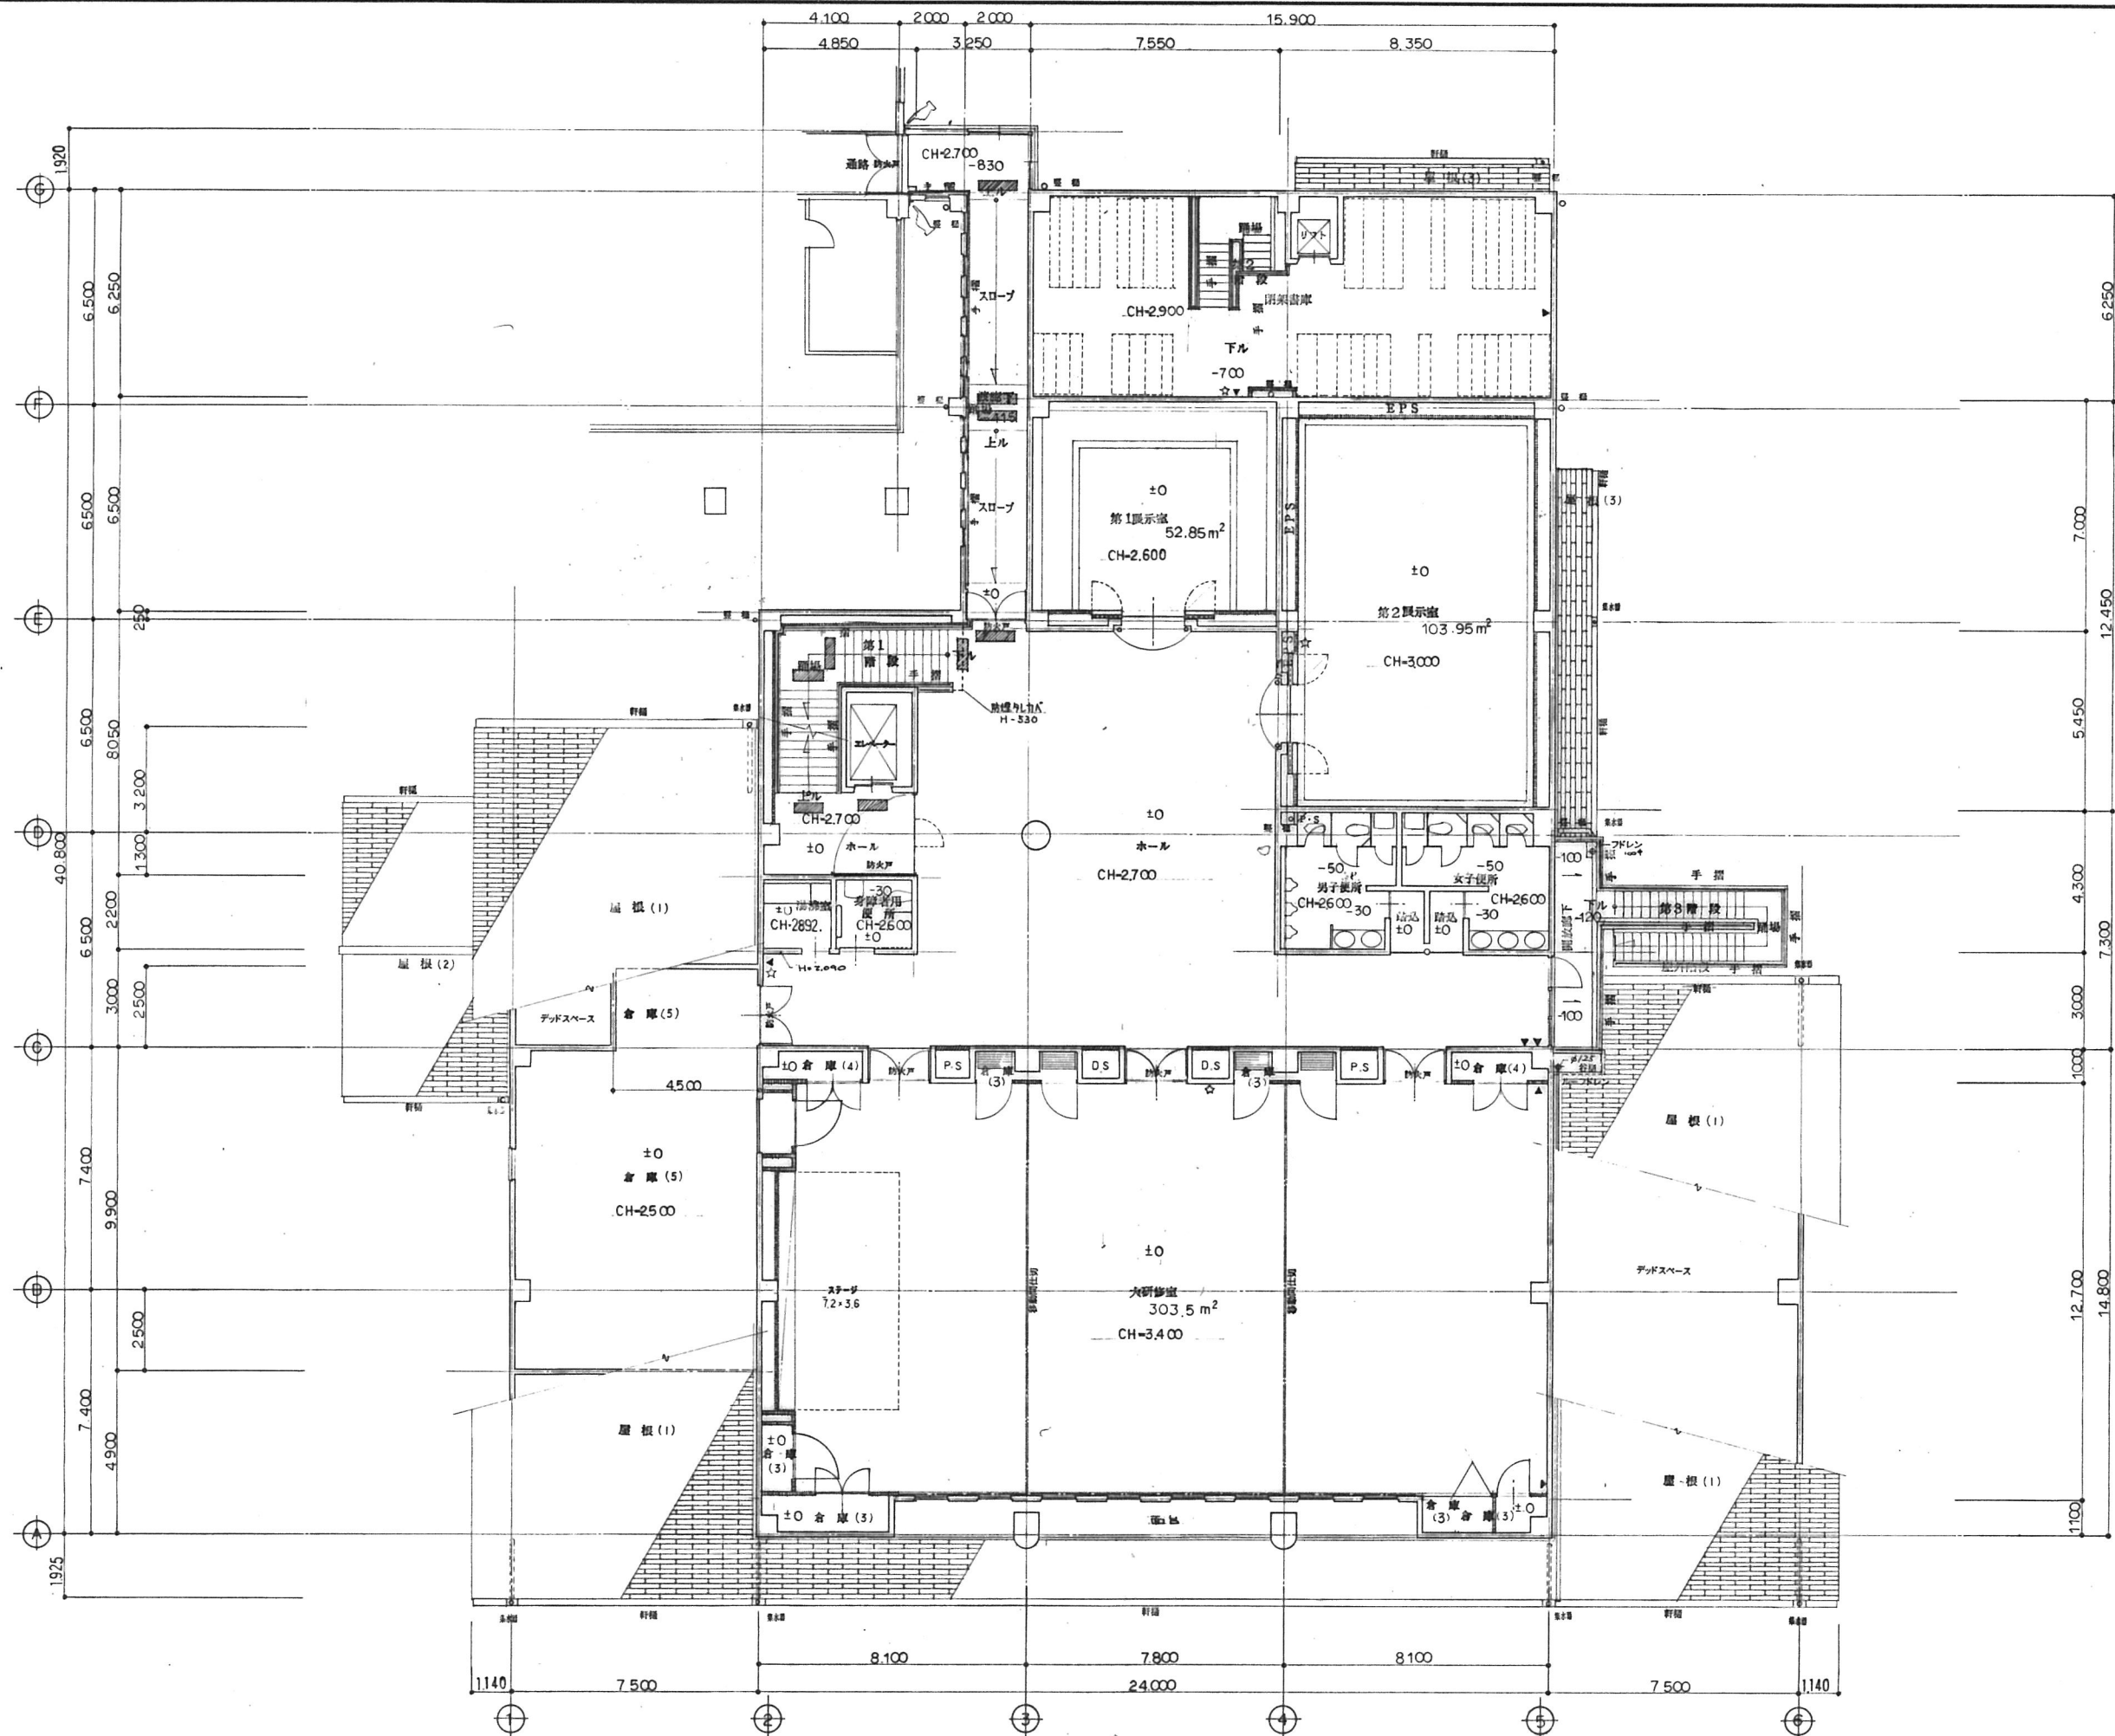


2 階 平 面 図 S = 1 : 100



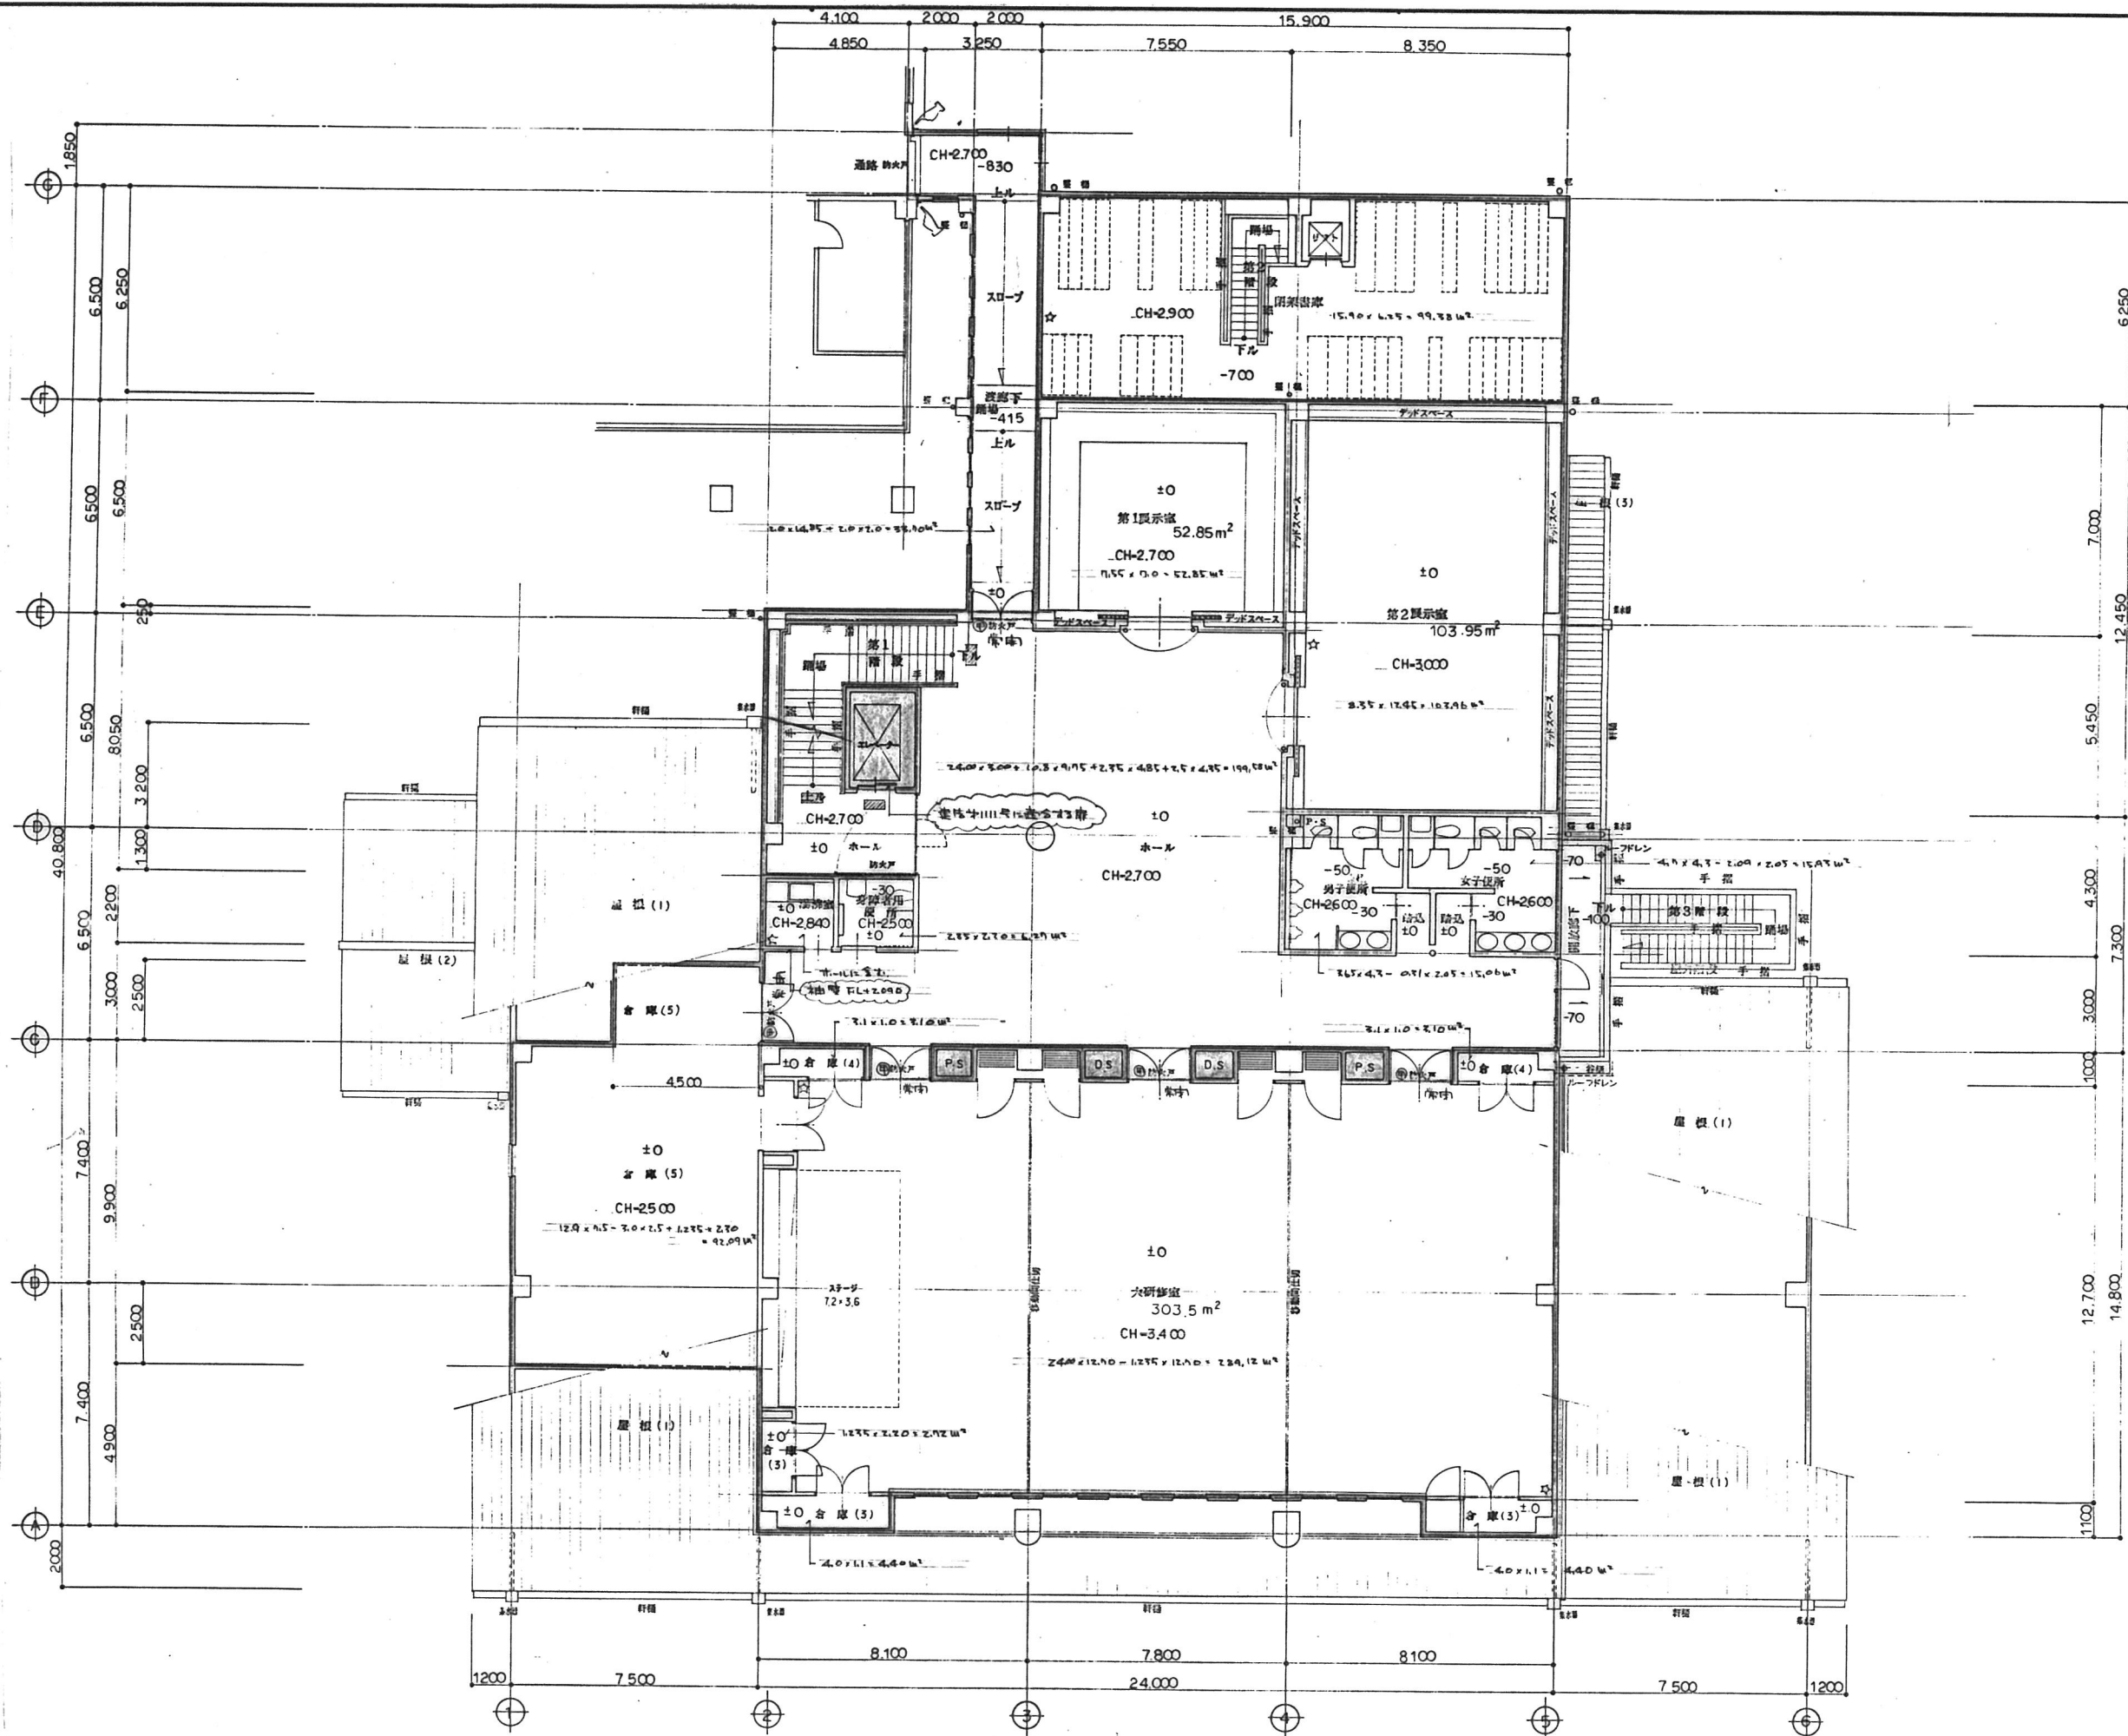


2 階平面図 S=1:100

階	室名	床面積 (㎡)	必要面積 (㎡)			有効面積 (㎡)			備考
			採光 1/20	換気 1/20	排煙 1/50	採光	換気	排煙	
1	市-1L市庁裏面廊下 EV市-1L 0-1	81.43	—	—	1.63			500-1 AW-14 $0.45 \times 1.80 + 0.35 \times 1.93 \times 2 = 2.19 > 1.63$	市庁裏面廊下(市庁裏面廊下)の換気口は、 $0.35 \times 1.93 = 0.67 < 0.35 \times 1.93 = 0.67$ OK 0-1市庁裏面廊下(市庁裏面廊下)の換気口は、 $0.35 \times 1.93 = 0.67 < 0.35 \times 1.93 = 0.67$ OK
	南壁窓 4-1	443.46	24.63	—	9.87	AW-2, AW-15 $(0.60 + 2.01) \times 0.9 \times 2.0 = 4.68 > 9.87$	OK	機械換気(別図参照)	OK
	南壁窓 4-2, 倉庫(1)	226.30	11.32	—	4.53	AW-2, AW-15 $(0.60 + 2.01) \times 0.9 \times 2.14 = 11.32$	OK	機械換気(別図参照)	OK
	福祉2-1	9.10	0.46	0.46	0.19	AW-4 $1.810 \times 1.50 = 2.715 > 0.46$	OK	AW-4 $0.90 \times 1.810 = 1.62 > 0.46$	OK
	高圧変圧室	95.94	4.80	4.80	1.92	AW-7, AW-8 $2.97 \times 1.810 + 3.18 \times 1.81 + 0.8 \times 2.56 \times 1.81 > 4.80$	OK	AW-7, AW-8 $0.95 \times 1.81 + 1.0 \times 1.81 + 1.0 \times 1.81 + 1.11 \times 1.81 \times 7.34 > 4.8$	OK
	車庫	56.38	—	—	1.14			AW-19 $0.855 \times 0.600 \times 3 = 1.53 > 1.14$	OK
	南壁窓	56.32	—	—	1.13			AW-10 $0.6 \times 2.20 = 1.32$	OK
	付随室	12.25	—	0.17	0.27		機械換気(別図参照)	OK	衛生433-3-2
	更衣室、倉庫	7.56	—	0.38	0.16		機械換気(別図参照)	OK	衛生433-3-1
	廊下	5.20	—	—	0.11				衛生433-3-1
	男子トイレ	15.82	—	—	0.32				衛生433-3-1
	女子トイレ	16.52	—	—	0.33				衛生433-3-1
	事務室用トイレ	6.00	—	—	0.12				衛生433-3-1
	市庁裏面廊下 倉庫(2)	2.04 3.63	—	—	0.04 0.08				衛生433-3-1
	市-1L	33.70	—	—	0.68			AW-11 $0.95 \times 0.76 + 0.8425 \times 0.76 = 1.33 > 0.68$	OK
2	市-1L、廊下	199.58	—	—	4.00			AW-17, AW-18, AW-20 $0.76 \times 0.860 \times 3 + 0.70 \times 0.57 \times 3 + 0.76 \times 0.54 \times 2 = 4.01 > 4.00$	OK
	大研修室	289.12	14.46	14.46	5.18	AW-16 $4.0 \times 2.0 \times 3 = 12.00 > 14.46$	OK	AW-16, AW-20 (衛生433-3-1参照)	OK
	市1展示室	52.85	—	2.64	1.06		機械換気(別図参照)	OK	衛生433-3-2
	市2展示室	103.96	—	5.20	2.08		機械換気(別図参照)	OK	AW-10 $0.5 \times 2.5 \times 2 = 2.50 > 2.08$
	南壁窓	99.38	—	—	1.99			AW-18, 10 $0.6 \times 2.5 \times 2.1 > 1.99$	OK
	事務室用トイレ 男子トイレ、女子トイレ	15.20 15.93	—	—	0.13 0.20 0.32				衛生433-3-1
	倉庫(3)	92.09	—	—	1.85				衛生433-3-1
	倉庫(3)(4)	4.00 3.10	—	—	0.09 0.06				衛生433-3-1
	市-1L	33.70	—	—	0.68			AW-11 $0.95 \times 0.76 + 0.8425 \times 0.76 = 1.33 > 0.68$	OK
	市-1L	63.26	—	—	1.27			AW-3 $1.8 \times 0.76 = 1.37 > 1.27$	OK



A	44.60	2.50	111.50
B	44.60	2.50	111.50
C	7.20	2.50	18.00
D	32.20	1.60	51.52
E	35.80	0.70	25.06
F	35.60	1.50	53.40
計			370.98
合 計		x 1/2	185.49

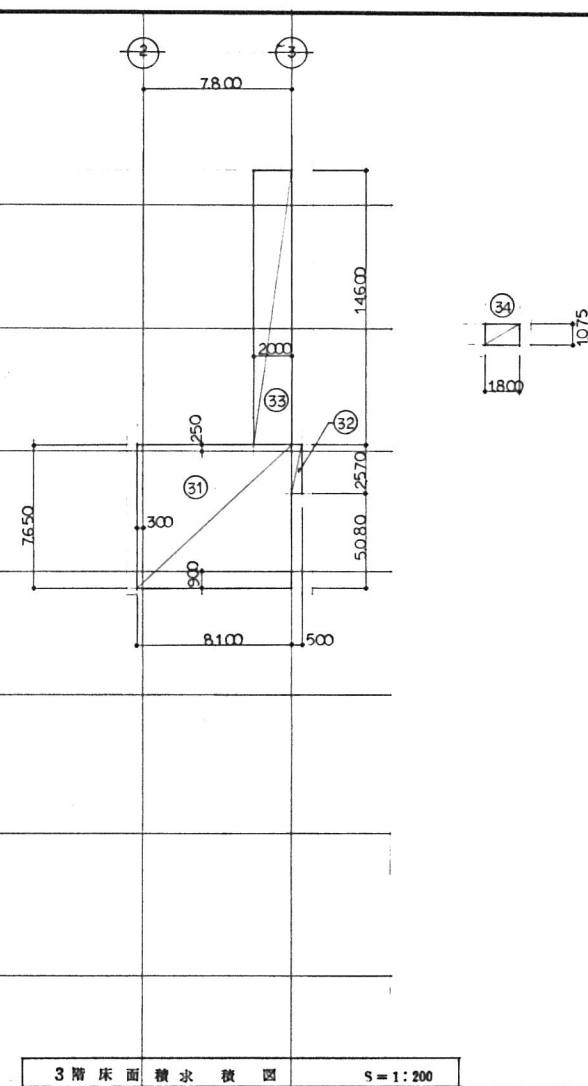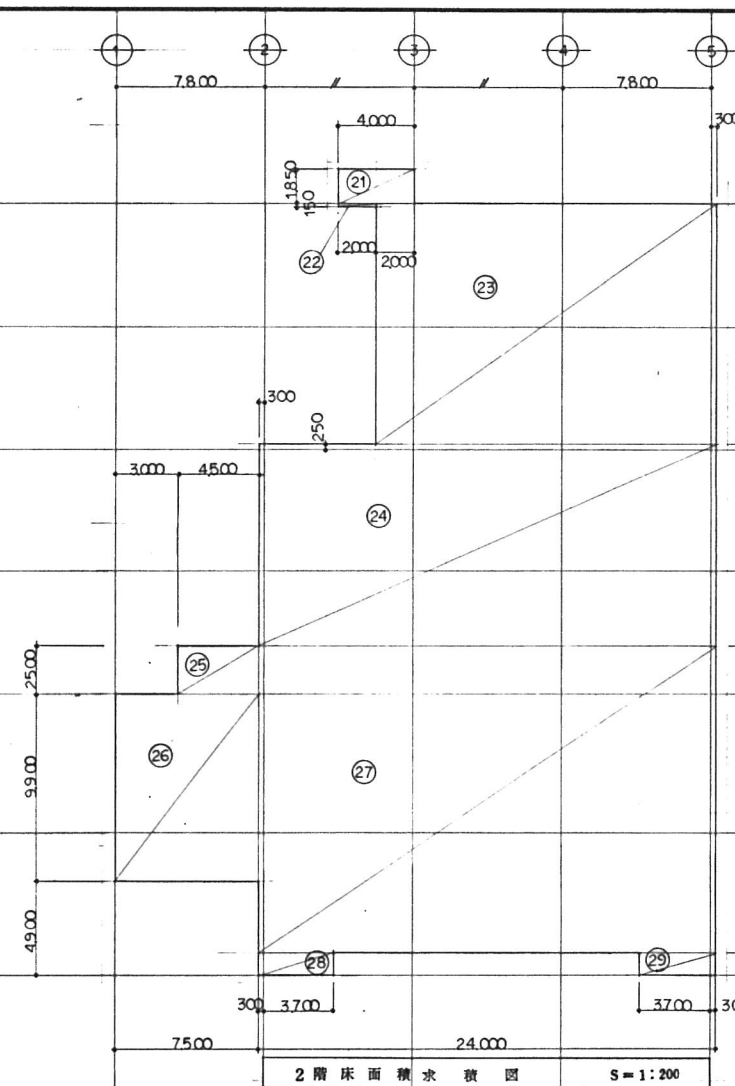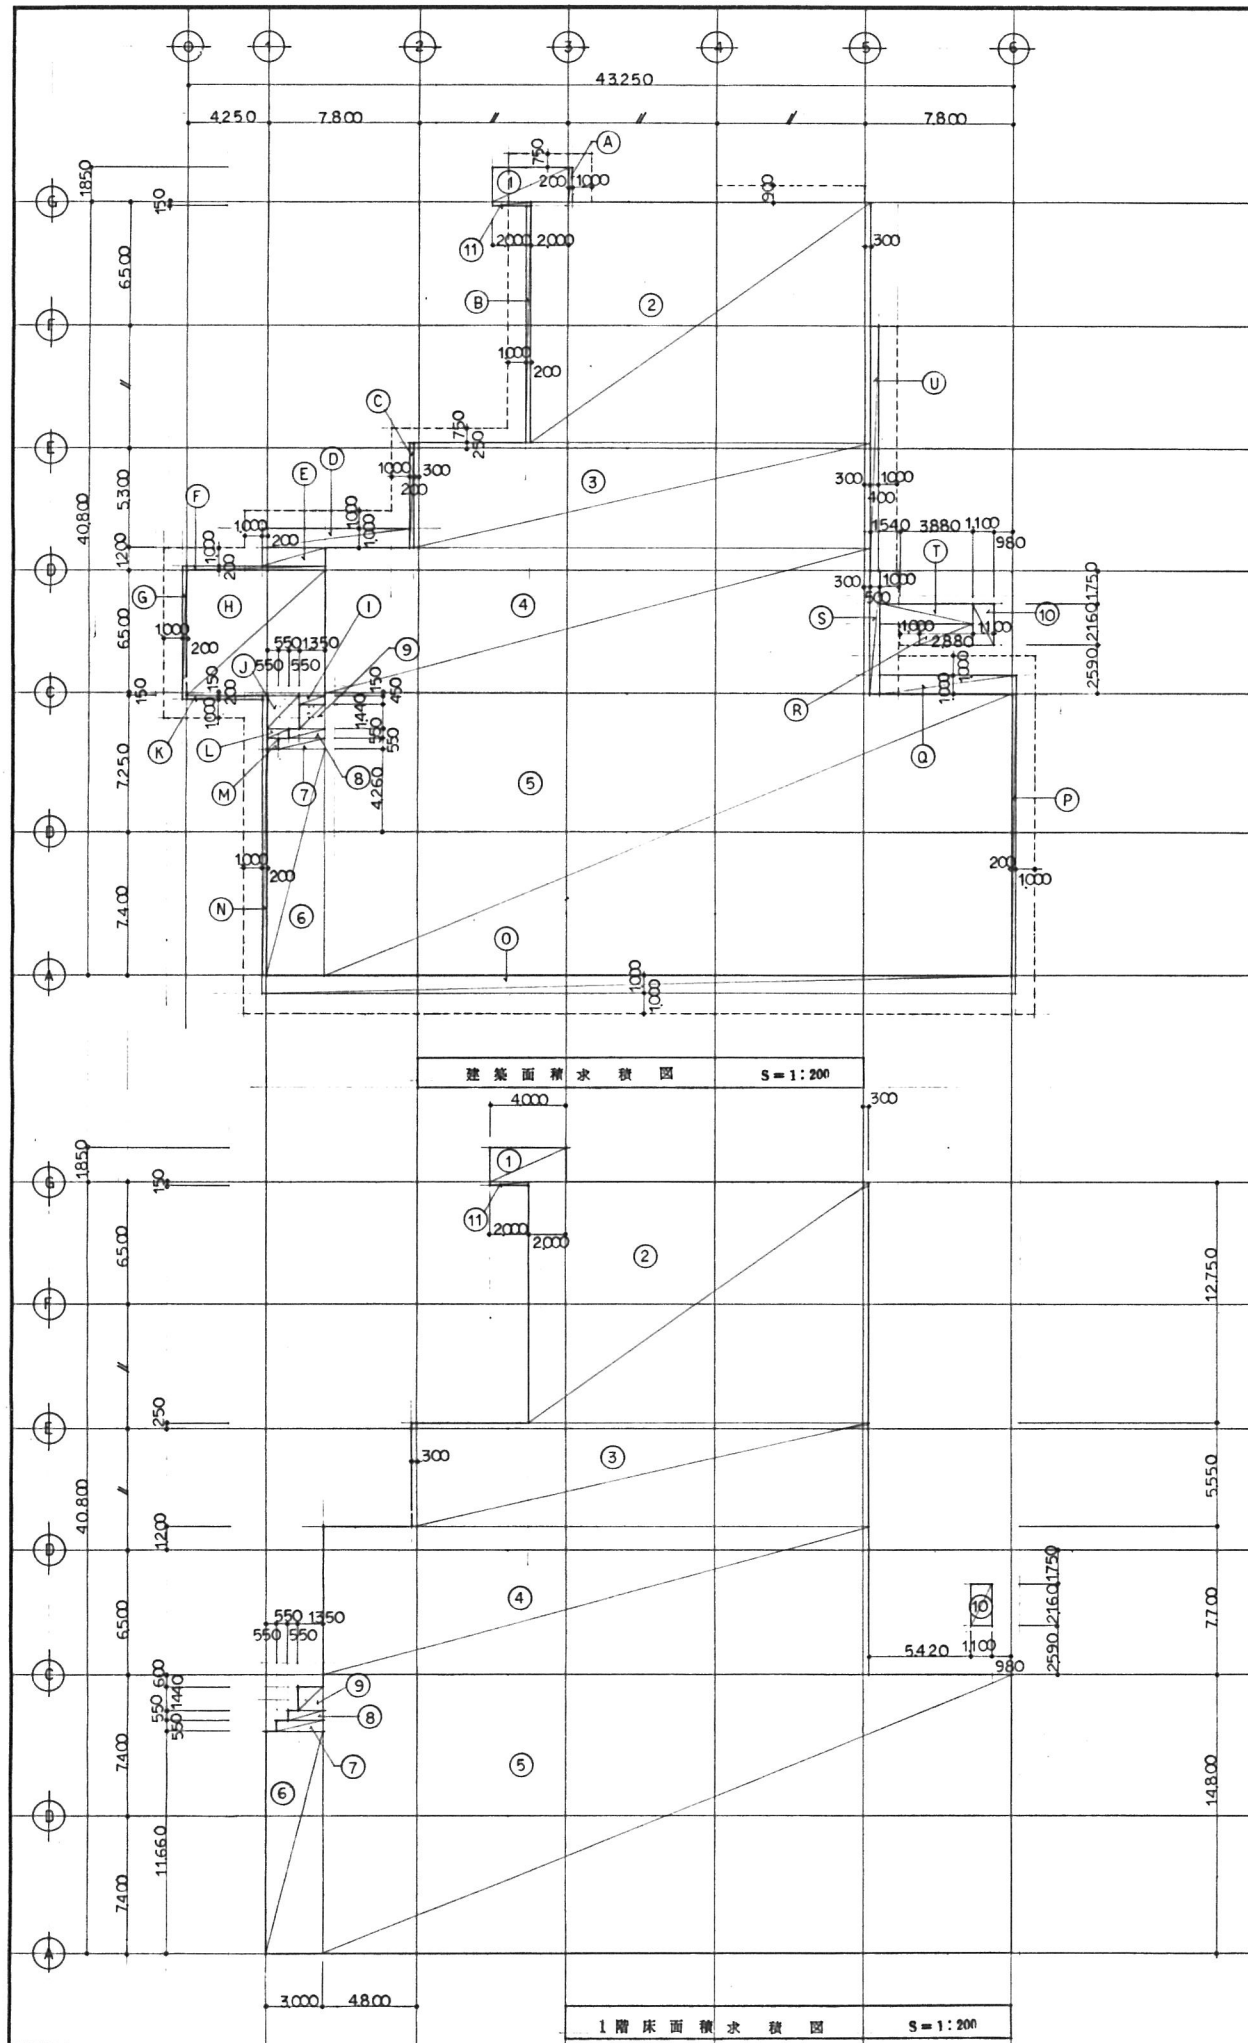

1階床面積							
1	4.000	1.850	7.40	1	4.000	1.850	7.40
2	12.750	17.900	228.22	2	12.750	17.900	228.22
3	5.550	24.000	133.20	3	5.550	24.000	133.20
4	7.700	28.500	219.45	4	7.700	28.500	219.45
5	14.800	36.000	532.80	5	14.800	36.000	532.80
6	11.660	3.000	34.98	6	11.660	3.000	34.98
7	2.450	0.550	1.34	7	2.450	0.550	1.34
8	1.900	0.550	1.04	8	1.900	0.550	1.04
9	1.350	1.440	1.94	9	1.350	1.440	1.94
10	1.100	2.160	2.37	10	1.100	2.160	2.37
11	0.150	2.000	0.30	11	0.150	2.000	0.30
			1163.04 m ²				1163.04 m ²
2階床面積							
21	4.000	1.850	7.40	21	4.000	1.850	7.40
22	0.150	2.000	0.30	22	0.150	2.000	0.30
23	12.750	17.900	228.22	23	12.750	17.900	228.22
24	10.750	24.000	258.00	24	10.750	24.000	258.00
25	4.500	2.500	11.25	25	4.500	2.500	11.25
26	7.500	9.900	74.25	26	7.500	9.900	74.25
27	16.200	24.000	388.80	27	16.200	24.000	388.80
28	4.000	1.100	4.40	28	4.000	1.100	4.40
29	4.000	1.100	4.40	29	4.000	1.100	4.40
			977.02 m ²				977.02 m ²
3階床面積							
31	7.650	8.100	61.96	31	7.650	8.100	61.96
32	2.570	0.500	1.28	32	2.570	0.500	1.28
33	14.600	2.000	29.20	33	14.600	2.000	29.20
34	1.800	1.075	1.93	34	1.800	1.075	1.93
			94.37				94.37
			2234.43 m ²				2234.43 m ²
建築面積							
			1272.07 m ²				1272.07 m ²

